
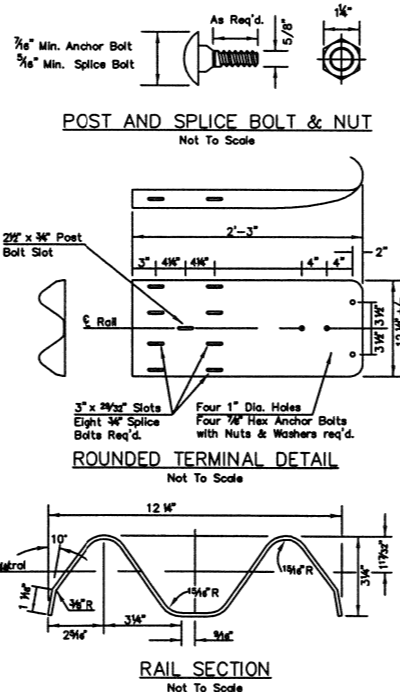


- GENERAL NOTES**
- SUBGRADE AND FILL**
- All fill and lime subgrades shall be placed in 8" compacted lifts and be compacted to 95% of Standard Proctor at a moisture range of 0% to plus 6% of optimum moisture. Moisture level must be maintained, by wetting or application of asphalt emulsion prime coat (0.25 to 0.50 gal/S.Y.) if necessary, until placing of concrete paving. All fill and lime subgrade for streets shall have densities taken at a rate of one density per 300 L.F. of street. Gradations shall be at a rate of one per 300 L.F. minimum of 60% passing #4 Sieve and 100% passing 1/2" Sieve. Locations of densities and gradations shall be determined by the City Public Works Construction Inspector.
  - For L1 and L2 streets, 6" Lime stabilized subgrade shall be constructed using Type "A" Hydrated Lime at an application rate of 33 lbs./S.Y., per NCTCOG Section 2.5.2. All other streets shall have 6" Lime at an application rate of 44 lbs./S.Y., per NCTCOG Section 2.5.2.
  - Final backfill of medians not to be covered with concrete or pavestone shall be sandy loam or topsoil approved by the City Engineer.
  - Slopes from back of sidewalk to property line are to be a maximum of 4:1, and slopes from curb to sidewalk are to be 1/4" per foot towards curb. Sidewalk cross-slope may be tilted toward or away from street in order to eliminate standing water and maintain natural drainage patterns.
  - Sand may not be used for level-up under paving.
- PAVING**
- Concrete pavement, curb & gutter, sidewalks and driveways are to be 3600 P.S.I., 28-day strength, 6 sacks cement per cu. yd. minimum, with 1" to 3" slump for machine pours and 3" to 5" slump for hand pours. Fly ash may be substituted for up to 20% of the cement content requirement at a 1 to 1.25 cement to fly ash substitution rate.
  - Reinforcing shall be #4 bars at 18" C.C. each way. Reinforcing shall conform to ASTM A-615 and be a minimum grade of 60 per ASTM A-370. Reinforcing steel bar laps are to be 30 bar diameters or 15" per ACI 318, section 12.15, whichever is greater. 50% of intersections are to be secured with tie wire and supported with chairs.
  - All concrete must be mechanically vibrated.
  - All concrete is to be membrane cured for 72 hours minimum. White curing compound is to be applied, per manufacturer's recommendations, to all exposed concrete surfaces (including backs-of-curb) immediately after completion of paving operations, per ASTM C-309, Type 2, NCTCOG Section 2.2.1(b)(1).
  - Finish all concrete street paving wider than 37' with a tine finish (1"), perpendicular to traffic flow, broom curb and gutter parallel to traffic 12" from curb. Broom finish median paving.
  - No vehicle traffic shall be permitted on newly paved areas for seven days after pour or until 3000 P.S.I. is achieved.
  - Extend all sawed contraction joints in streets and alleys through private drive approaches to the first expansion joint.
  - Joint sealer is to be a hot-poured, rubber base compound, ASTM D-3406, per NCTCOG 2.2.10(b).
  - If lime subgrade is not installed under left turn lane, increase paving depth to 12".
  - Medians under 7' in width, from back-of-curb to back-of-curb, shall be covered with 4" concrete median pavement or 4" concrete slab with 3.5" Pavestone (Holland Stone Antique Red).
  - Divided paving sections may vary depending on adopted City Thoroughfare Plan classification and City Engineer.
  - Divided streets require continuous 2" PVC street lighting conduit and irrigation systems. Consult the City Engineer for details (Ord. No. 2617).
  - Maximum allowable driveway approach slopes are as follows:
- |      | Street | Alley |
|------|--------|-------|
| Com. | 7%     | 11%   |
| Res. | 10%    | 14%   |
- TRAFFIC CONTROL**
- Contractor shall provide traffic control plan at least 48 hours prior to any work in a city street. Traffic control measures shall conform to the Texas Manual on Uniform Traffic Control Devices and the City Work Zone Traffic Control Guidelines. Traffic control measures shall be installed for any work activity that takes place on or adjacent to any city street or roadway. The City Engineer may require the traffic control plan to be designed and sealed by an engineer licensed in the State of Texas.
  - Contractor shall contact the Traffic Engineering Division, (972) 216-6917, at least 48 hours prior to work requiring the removal or relocation of traffic signs, traffic control equipment or other traffic control appurtenances.
- ADA REQUIREMENTS**
- A wheelchair ramp must be constructed for all street intersections per TxDOT Roadway Standard Details PED-05 (four sheets).
  - No obstructions (fire hydrants, power poles, guy wires, etc.) shall be allowed in or over sidewalk paving.

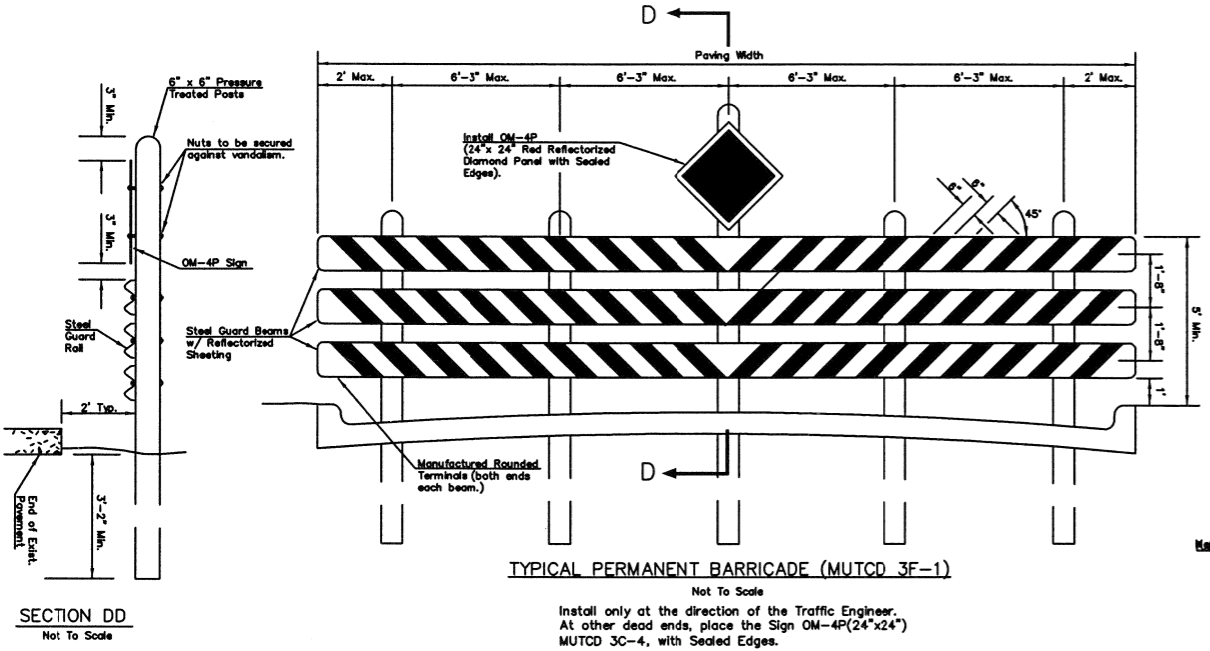

- Barricade Notes:**
- The exact location and height of Metal Beam Guard Fence shall be as directed by Engineer.
  - Bolts shall be 5/8" diameter, Galvanized, and of sufficient length to extend through the full thickness of the nut and no more than 3/4" beyond it.
  - Posts to be backfilled with a cohesionless material. Do not backfill timber posts with concrete. Posts shall be 7" Dia. Creosote Treated Wood.
  - Metal beams, bolts, splices and all fittings to be Galvanized.
  - Red Reflectorized Stripes shall be High Intensity Sheeting.
  - Directional signs may be required on Barricades at discretion of the Traffic Engineer (S.D.H.P.T. CW-6 or CW-7).
  - Consult the Texas Manual of Uniform Traffic Control Devices for direction of striping.

APPROVED: *Matthew H. [Signature]* CITY ENGINEER Date: 11-30-05

REVISION HISTORY		
Rev. No.	Date	Description
1	May '01	
2	Sept. '03	Complete Revision
3	Nov. '05	Revised Layout

**PAVING SHEET TWO**  
**ENGINEERING DIVISION**  
**STANDARD DETAILS**  
**City of Mesquite, Texas**

DATE	SCALE	FILE
November 2005	N.T.S.	Paving Sheet 2